


Idaho NEEA Field Observations

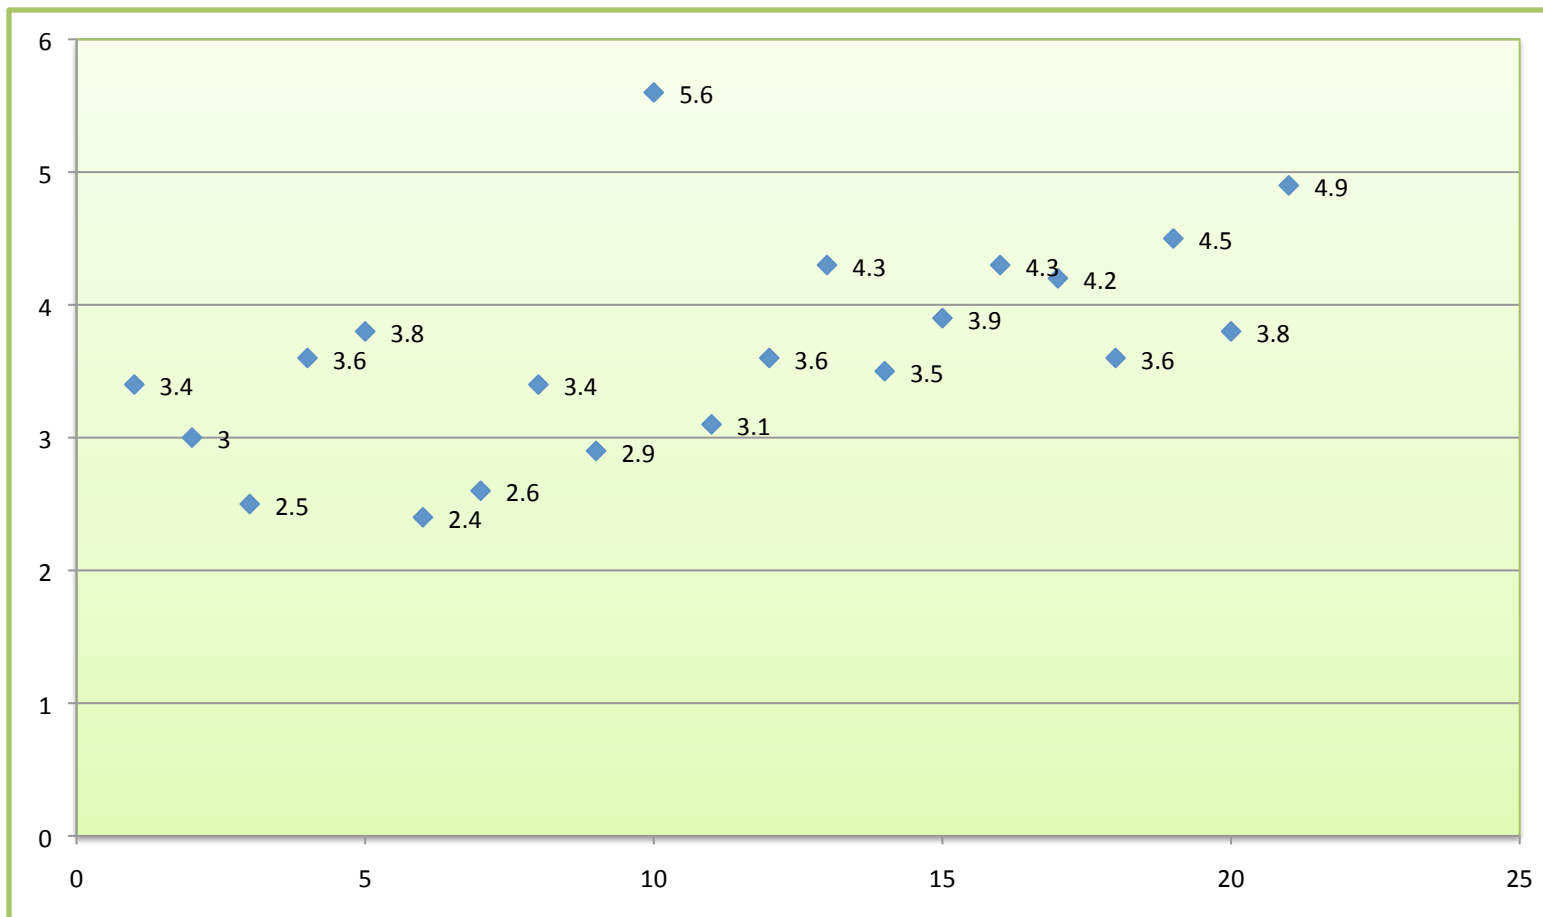

Blower door
results on 21
homes – 2013


Average
ACH@50 is 3.6

Idaho NEEA Field Observations

Average ACH by Area

- 3.2 ACH@50 North Idaho
 - 4.0 ACH@50 SW Idaho
 - 3.35 ACH@50 East Idaho
 - 3.1 ACH@50 for Basements
 - 4.0ACH@50 for Crawlspace
-
-

Boise City Blower Door Data

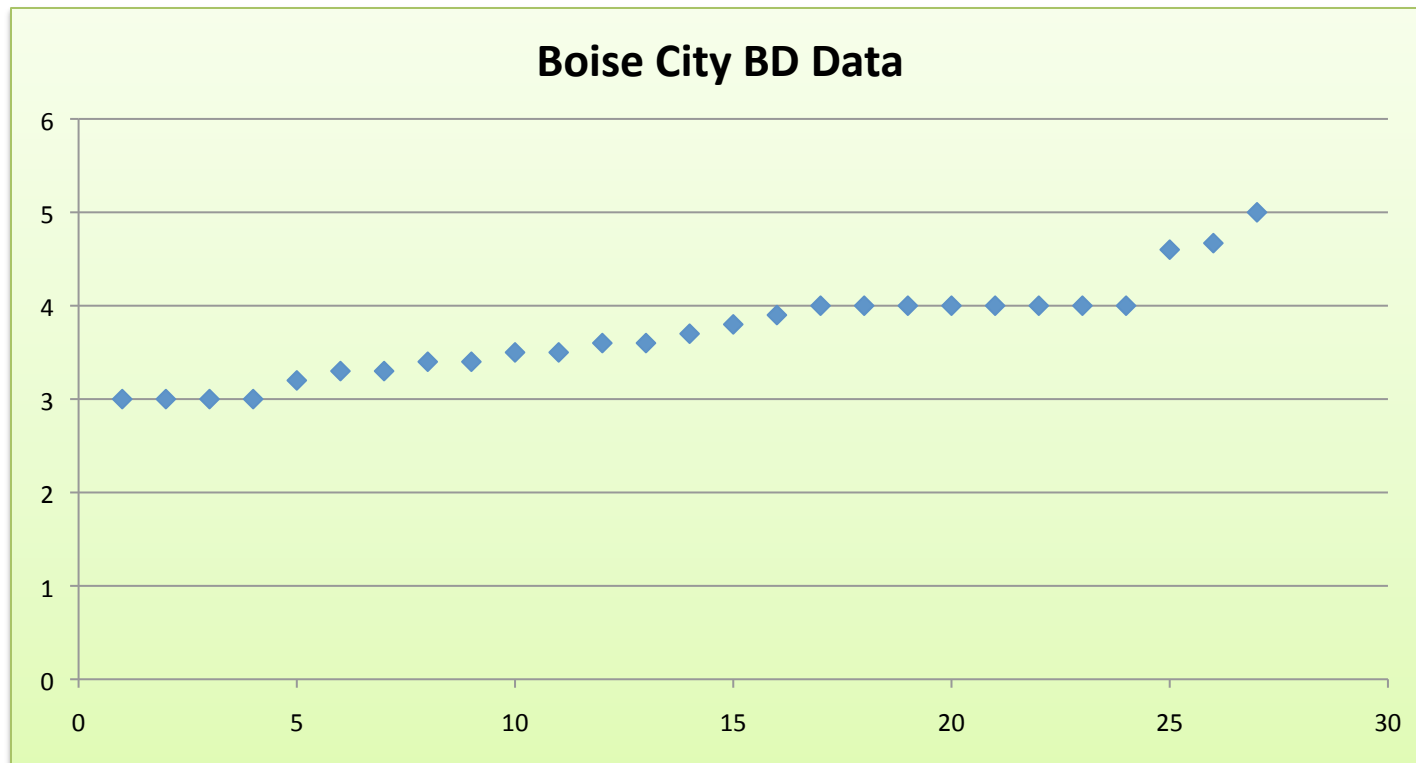

Blower door
results on 28
homes – 2013

Average
ACH@50 is 3.6

Average Boise area Northwest Energy Star

600 homes avg. 3.8 ACH@50



Where are we Going?

- I think the trend is that homes are getting tighter
 - We need to start talking about home ventilation
 - NEEA is currently studying residential ventilation in Washington State
-
-